


PEDESTAL PLAN

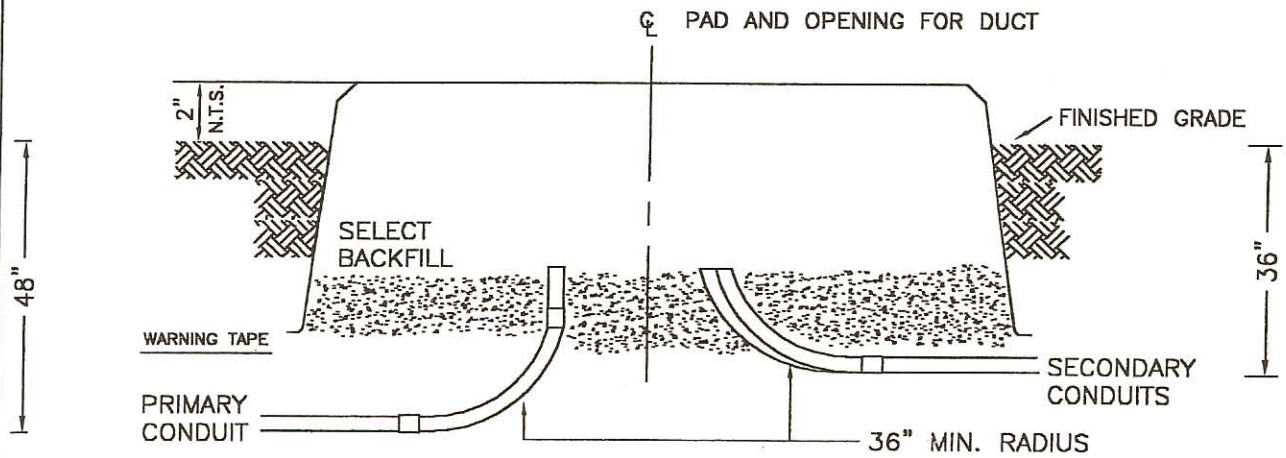

SECTION A-A

NOTES:

1. PEDESTAL TO BE FURNISHED BY REU AND INSTALLED BY CUSTOMER
2. PEDESTAL TO BE +/- 1/8" LEVEL

PREPARED BY:	KDB	FIBERGLASS PEDESTAL FOR SINGLE-PHASE PAD-MTD TRANSFORMER INSTALLATION DETAIL	SCALE: NONE	
CHECKED BY:	JD		DRAWING NUMBER	REV.
APPROVED BY:	KDB		UGS-002	0
ROCKWOOD ELECTRIC UTILITY 341 W. ROCKWOOD ST. ROCKWOOD, TN 37854				