



**REU PRIMARY ONLY**

**NOTES:**

1. CLEARANCES ARE SPECIFIED TO ACCOMMODATE FUTURE MAINTENANCE OF UNDERGROUND FACILITIES.
2. SELECTED BACKFILL SHALL BE FREE FROM ROCKS OR OTHER MATERIAL WHICH MIGHT DAMAGE CONDUIT.
3. CLEARANCE REQUIREMENTS OF OTHER UTILITIES SHALL GOVERN IF GREATER THAN SPECIFIED.
4. GAS, WATER, AND SEWER PIPING SHALL BE INSTALLED IN SEPARATE TRENCHES FROM ELECTRICAL.

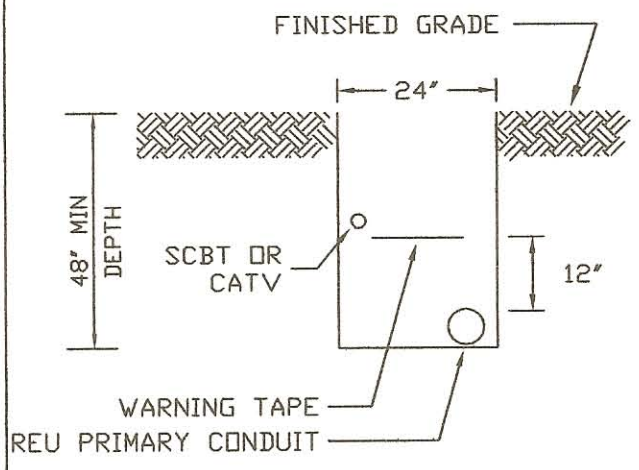

**REU PRIMARY & COMMUNICATIONS**

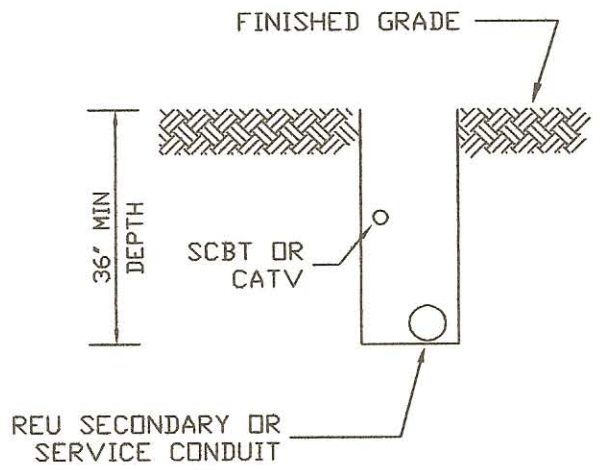

**REU SECONDARY & COMMUNICATIONS**

PREPARED BY:	KDB
CHECKED BY:	JD
APPROVED BY:	KDB
ROCKWOOD ELECTRIC UTILITY	
341 W. ROCKWOOD ST. ROCKWOOD, TN 37854	

**TRENCH REQUIREMENTS  
RESIDENTIAL INSTALLATIONS**

SCALE: NONE	
DRAWING NUMBER	REV.
UGS-001	0