



200A METER INSTALLATION UNDERGROUND - LEFT HAND

NOTES:

1. FOR LOCATION OF METERBASE CONTACT REU ENGINEERING DEPARTMENT. IF CONTACT IS NOT MADE, RELOCATION OF METERBASE MAY BE REQUIRED.
2. METERBASE SHOULD BE MOUNTED SO THE CENTER OF THE METER IS NOT MORE THAN 6'-0" AND NO LESS THAN 5'-0" FROM FINISHED GRADE.
3. CUSTOMER'S CONDUCTOR(S) SHALL NOT CROSS REU CONDUCTOR IN METER BASE.
4. CUSTOMER OR CONTRACTOR SHALL GROUND AT METER BASE IN ACCORDANCE WITH LOCAL CODES.
5. UNDERGROUND METER BASE MUST BE APPROVED FOR USE BY REU ENGINEERING DEPARTMENT.
6. DISCONNECT REQUIRED IF PANELBOARD IS REMOTELY LOCATED FROM METER SOCKET.
7. REU TO INSPECT CONDUIT SYSTEM BEFORE BACKFILL.

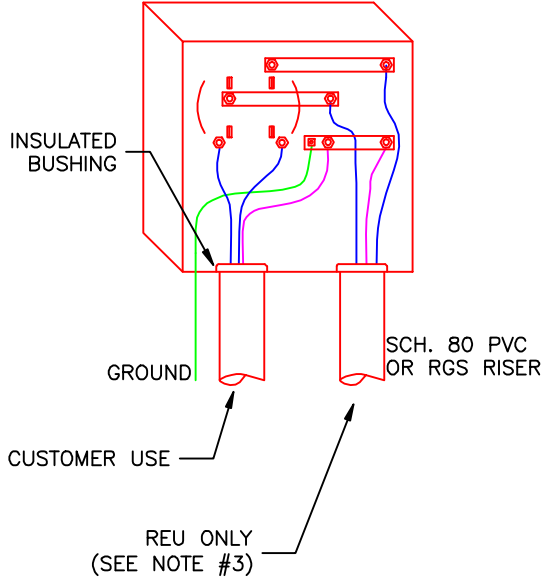

200A METER INSTALLATION UNDERGROUND - RIGHT HAND

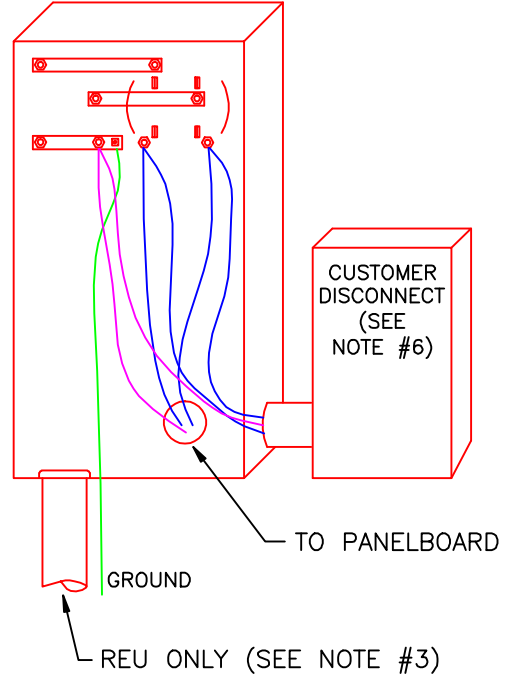

STANDARD 400A METER INSTALLATION - UNDERGROUND

PREPARED BY:	KDB
CHECKED BY:	JD
APPROVED BY:	KDB
ROCKWOOD ELECTRIC UTILITY	
341 W. ROCKWOOD ST. ROCKWOOD, TN 37854	

UNDERGROUND METERBASE
CONDUIT LOCATION FOR
RESIDENTIAL INSTALLATIONS

SCALE: NONE	
DRAWING NUMBER	REV.
UGS-006	0