


PEDESTAL PLAN

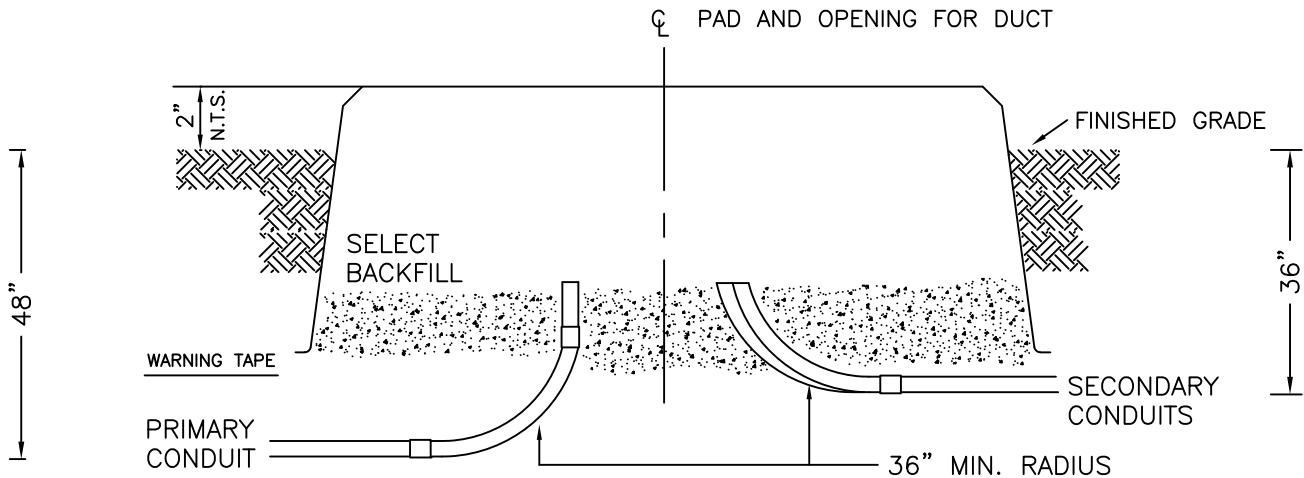

SECTION A-A

NOTES:

1. PEDESTAL TO BE FURNISHED BY REU AND INSTALLED +/- 1/8" LEVEL BY CUSTOMER
2. CUSTOMER TO PROVIDE AND INSTALL WARNING TAPE FOR ALL PRIMARY CONDUIT.
3. CUSTOMER TO INSTALL PULL STRING IN ALL CONDUIT

PREPARED BY:	KDB	FIBERGLASS PEDESTAL FOR SINGLE-PHASE PAD-MTD TRANSFORMER INSTALLATION DETAIL	SCALE: NONE	
CHECKED BY:	JD		DRAWING NUMBER UGS- 002	REV. 1
APPROVED BY:	KDB			
ROCKWOOD ELECTRIC UTILITY 341 W. ROCKWOOD ST. ROCKWOOD, TN 37854				