



**REU PRIMARY ONLY**

**NOTES:**

1. CLEARANCES ARE SPECIFIED TO ACCOMMODATE FUTURE MAINTENANCE OF UNDERGROUND FACILITIES.
2. SELECTED BACKFILL SHALL BE FREE FROM ROCKS OR OTHER MATERIAL WHICH MIGHT DAMAGE CONDUIT.
3. CLEARANCE REQUIREMENTS OF OTHER UTILITIES SHALL GOVERN IF GREATER THAN SPECIFIED.
4. GAS, WATER, AND SEWER PIPING SHALL BE INSTALLED IN SEPARATE TRENCHES FROM ELECTRICAL.
5. CUSTOMER IS RESPONSIBLE FOR ALL TRENCHING, CONDUIT, BACKFILL, AND INSTALLING A PULL STRING.

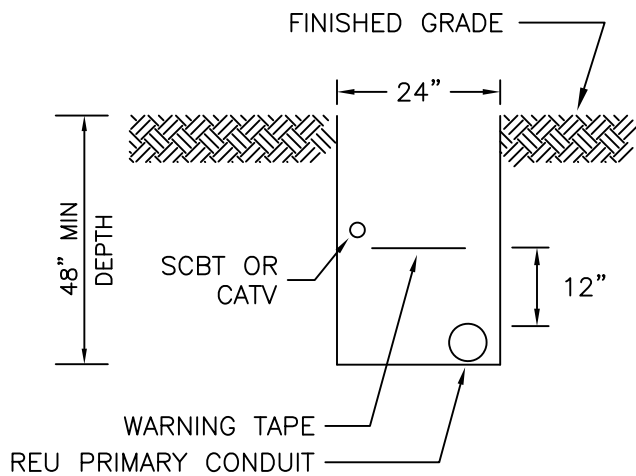

**REU PRIMARY & COMMUNICATIONS**

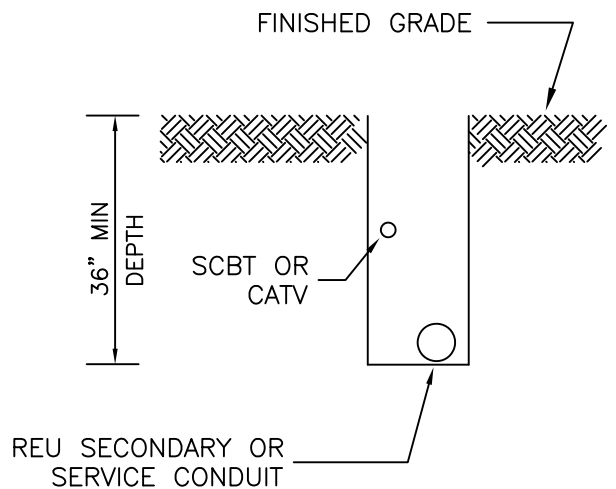

**REU SECONDARY & COMMUNICATIONS**

PREPARED BY:	KDB
CHECKED BY:	JD
APPROVED BY:	KDB
ROCKWOOD ELECTRIC UTILITY	
341 W. ROCKWOOD ST. ROCKWOOD, TN 37854	

TRENCH REQUIREMENTS  
GRANDE VISTA BAY

SCALE: NONE	
DRAWING NUMBER	REV.
UGS-001	0