


NOTES:

1. CONDUIT SHALL BE SCH 40 PVC UNLESS PRIOR APPROVAL OBTAINED FROM REU.
2. METER TO BE SPOTTED ON STRUCTURE BY REU.
3. CONDUIT ABOVE GRADE SHALL BE SCH 80 PVC.
4. METER BASES MUST BE APPROVED FOR USE BY REU.
5. WARNING TAPE TO BE PROVIDED AND INSTALLED BY CUSTOMER FOR ALL PRIMARY CONDUIT.
6. PULL STRING TO BE PROVIDED AND INSTALLED BY CUSTOMER IN ALL CONDUIT.

SERVICE ENTRANCE SIZE (AMPS)	CONDUIT SIZE	WIRE SIZE
100	2"	#2/0
200	2 1/2"	#4/0
400	3"	350 kcmil

TABLE 1

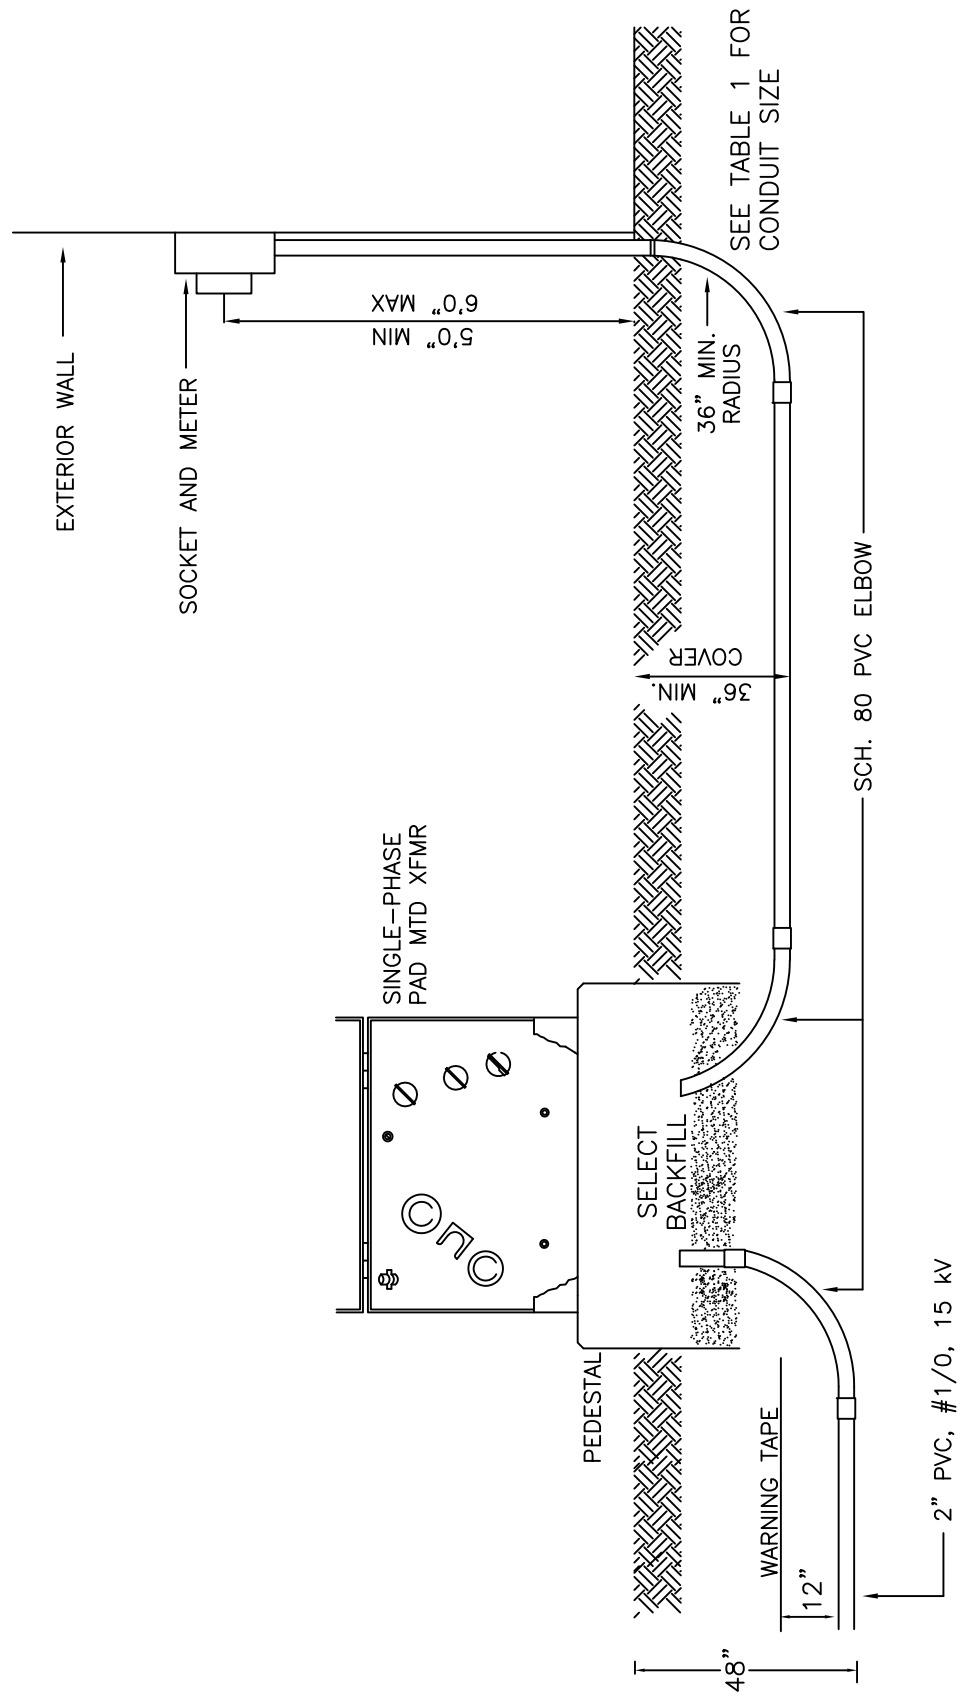

PREPARED BY: KDB
 CHECKED BY: JD
 APPROVED BY: KDB
 ROCKWOOD ELECTRIC UTILITY
 341 W. ROCKWOOD ST.
 ROCKWOOD, TN 37854

PAD MOUNTED
 RESIDENTIAL SERVICE
 200 - 400 AMP

SCALE: NONE
 DRAWING NUMBER: UGS-003
 REV. 1