


SERVICE ENTRANCE SIZE (AMPS)	CONDUIT SIZE	WIRE SIZE
200	2 1/2"	#4/0
400	3"	350 kcmil

TABLE 1

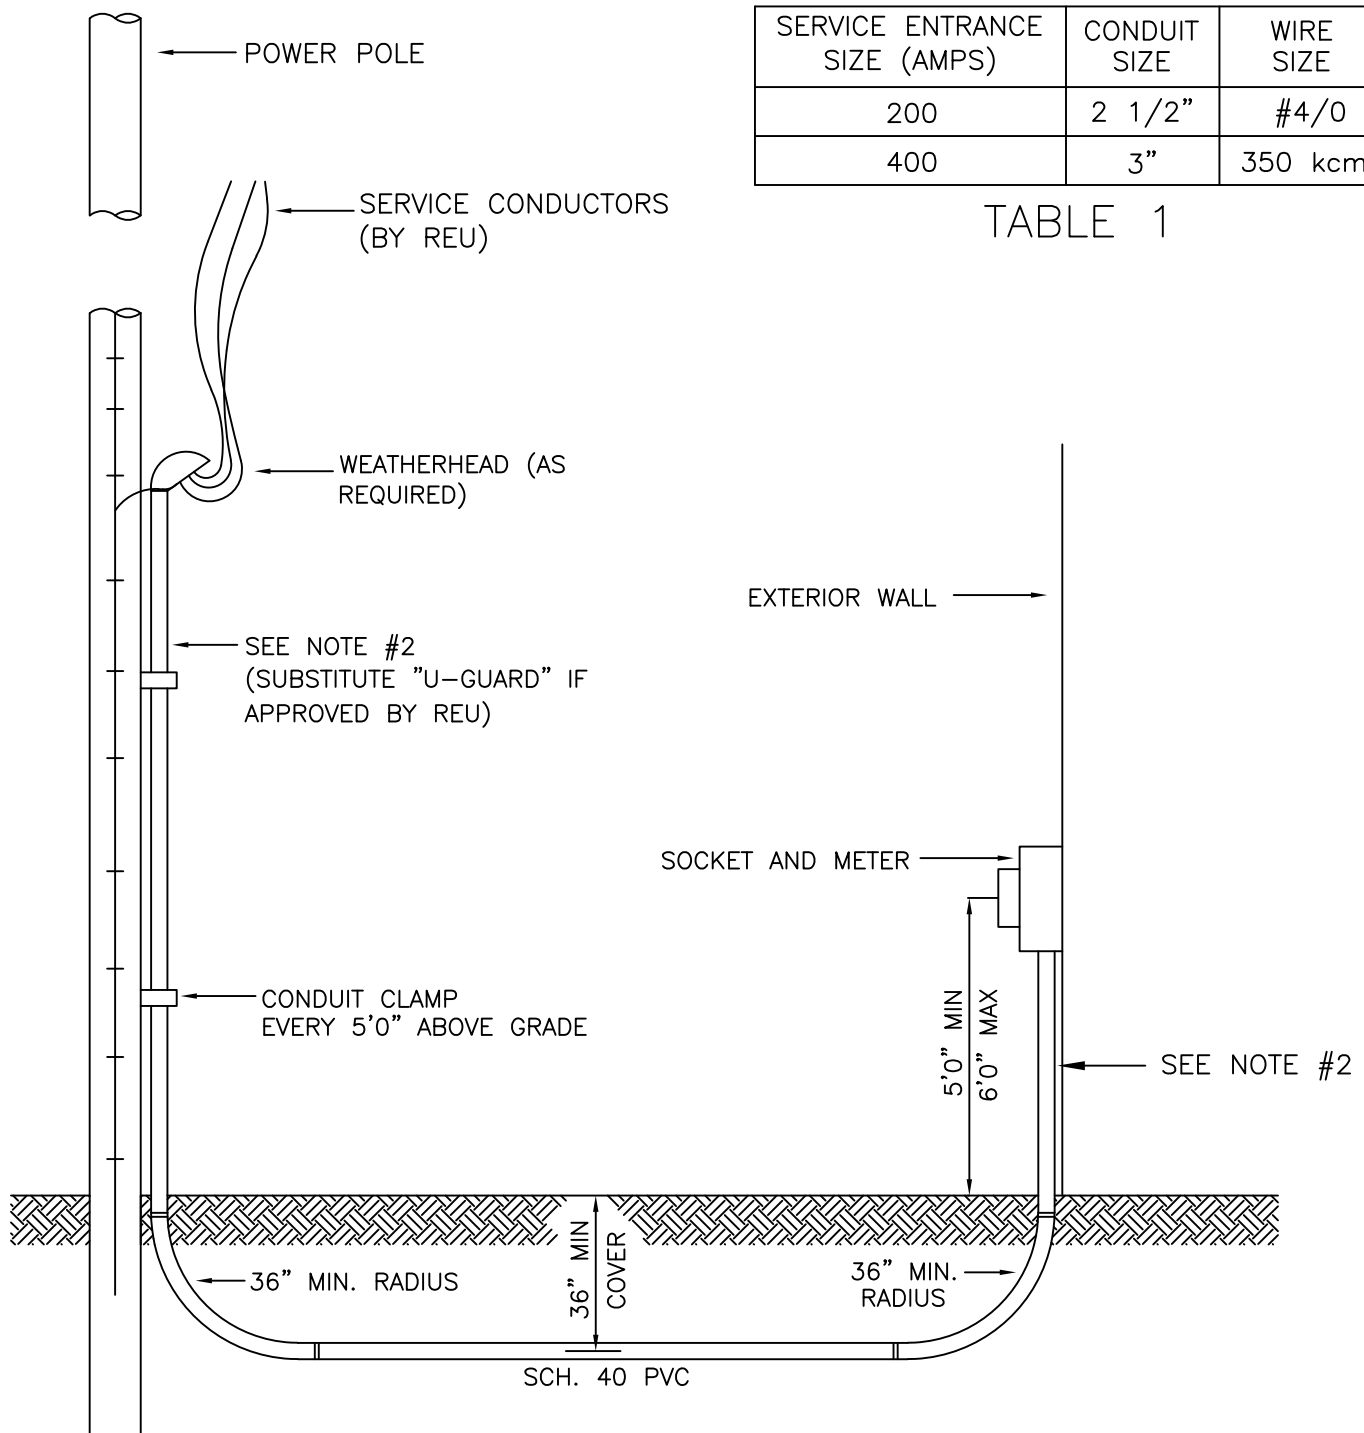

NOTES:

1. CONDUIT BELOW GRADE SHALL BE SCH 40 PVC UNLESS PRIOR APPROVAL OBTAINED FROM REU.
2. EXPOSED CONDUIT SHALL BE SCH 80 PVC OR EQUAL TO A POINT AT LEAST 8'-0" ABOVE FINISHED GRADE.
3. METER TO BE SPOTTED ON STRUCTURE BY REU.
4. CUSTOMER TO SUPPLY ALL TRENCHING, BACKFILL, CONDUIT, CLAMPS, AND WEATHERHEAD. INSTALL PULL STRING IN ALL CONDUIT.

PREPARED BY:	KDB
CHECKED BY:	JD
APPROVED BY:	KDB
ROCKWOOD ELECTRIC UTILITY	
341 W. ROCKWOOD ST. ROCKWOOD, TN 37854	

TYPICAL SINGLE-PHASE
SECONDARY URD SERVICE

SCALE: NONE	
DRAWING NUMBER	REV.
UGS-004	1